



SUBMITTAL : GS5-45HPC-D & ECO-83SSAQB 83 Gallon Tank



Job Name	Location
Purchaser	Engineer
Submitted to	Reference <input type="checkbox"/> Approval <input type="checkbox"/> Construction <input type="checkbox"/>
Unit Designation	Schedule #

Specifications	GS5-45HPC-D
Performance	
Uniform Energy Factor	3.80
Uniform First Hour Rating	121 Gallons
Nom Heating Capacity (Btu/h)	15,400 Btu/h
Nom Heating Capacity (kw)	4.5kw
Heating COP @ 80/47/17°F	5.5 / 4.2 / 2.8
Water Temperature Setting (°F)	145°F or 150°F
Refrigerant Type	R744 (CO ₂)
Refrigerant Charge (Oz)	25.4oz (720g)
Power Voltage	208/230v-1Ph-60Hz
Breaker Size	15A
MCA (Amps)	7.2A
Compressor MRC (Amps)	5.0A
Fan Motor MOC/Watts	0.3A / 30W
Pump MOC/Watts	0.6A / 60W
Drain Pan Heater MOC/Watts	0.6A / 132W
Noise Level (DbA)	37
Weight (lbs)	110lbs
Storage Tank	
ECO-83SSAQB	
Nominal Volume	83 Gallons
Pressure Relief Valve (Psig & °F)	150 & 210°F
Temperature Sensor	Thermistor
Tank Weight (lbs)	115lbs
Standby Loss in 67°F Ambient	110 Btu/h
Tank Connection Sizes	
Cold Water Inlet	3/4" NPT
Hot Water Outlet	3/4" NPT
Cold Water to Heat Pump	3/4" NPT
Hot Water Return from HP	3/4" NPT
Pipe Size - Tank to Heat Pump	
Cold Water pipe - Tank to HP	1/2"
Hot Water pipe - HP to Tank	1/2"
Max Pipe Length inc	66ft
Max Vertical Separation of	23ft
Certifications	
Safety	ETL & ETLc
Performance	Energy Star
Warranty - System	
Heat Pump	3 Years Labor
Tank	10 Years Parts
	15Yrs Limited Lifetime

Construction

The Outdoor unit shall be galvanized steel with a baked on powder coated finish on all panels except for unit base

Heat Exchangers

Evaporator coil shall be mechanically bonded Aluminum fin to copper tube. Fins shall be coated to resist corrosion

The Refrigerant to Water HX (Gas Cooler) shall be a Double Wall type pressure tested to 6000 psi

Refrigerant System

Compressor shall be a hermetically sealed DC Inverter drive Rotary vane type Refrigerant shall be R744 (CO₂).

Refrigerant flow shall be controlled by EEV

Fan & Motor

The outdoor unit fan shall be a propeller type, driven by a BLDC Motor

Water Pump

The pump shall be a BLDC Impellor type

Controls

The unit shall be operated using a temperature sensor mounted in the Storage tank Control wiring shall require 18-2AWG shielded wire Ambient operating range shall be -25°F to 114°F A Modbus communication signal shall be accepted by the GS5 Heat Pump via a Controller that shall be supplied by ECO2 Systems as an accessory

Storage Tank

Storage tank shall be constructed from a blend of 316/444 Stainless Steel with R12 Insulation Storage Tank connections shall be NPT Connections shall be interchangeable as required

Interconnect Piping

Interconnect Piping shall be 1/2" copper or where permitted 1/2" PEX tubing Both Cold and Hot piping should be insulated with min 3/4" closed cell foam and where required Heat Trace tape shall be used to prevent pipes from freezing




**SUBMITTAL : GS5-45HPC-D
& ECO-83SSAQB 83 Gallon Tank**



Job Name	Location			
Purchaser	Engineer			
Submitted to	Reference <input type="checkbox"/>	Approval <input type="checkbox"/>	Construction <input type="checkbox"/>	
Unit Designation	Schedule #			

GS5-45HPC-D Dimensions

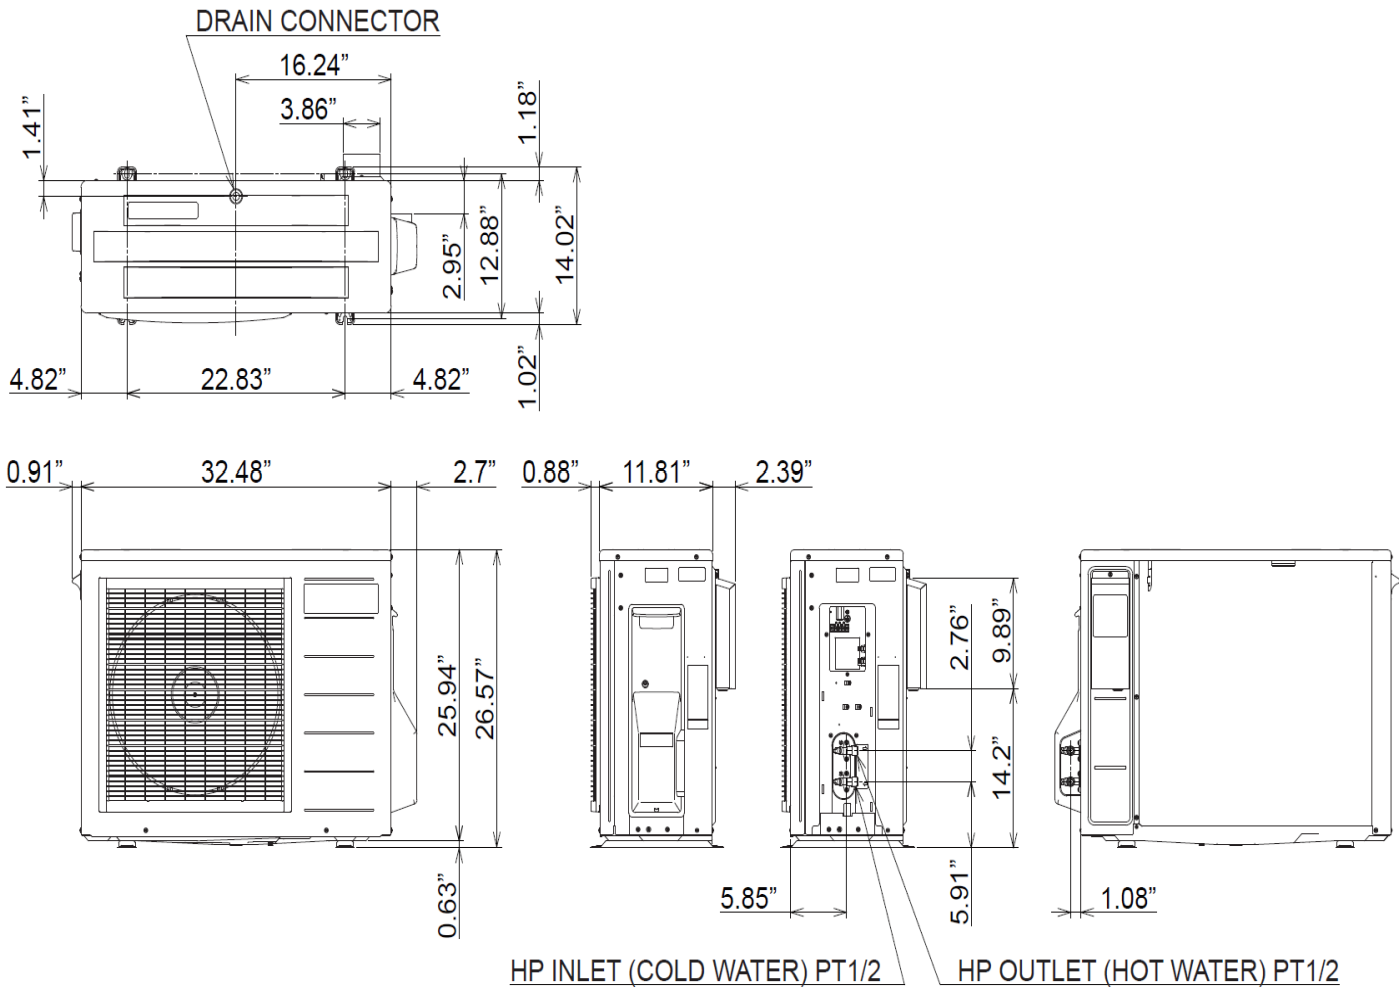

Unit: inch



SUBMITTAL : GS5-45HPC & ECO-83SSAQB 83 Gallon Tank



Job Name	Location			
Purchaser	Engineer			
Submitted to	Reference <input type="checkbox"/>	Approval <input type="checkbox"/>	Construction <input type="checkbox"/>	
Unit Designation	Schedule #			

ECO-83SSAQB Stainless Steel Storage Tank Dimensions

